


# 2014

Bethel

## Consumer Confidence Report



### Montgomery County Public Service Authority Water Systems

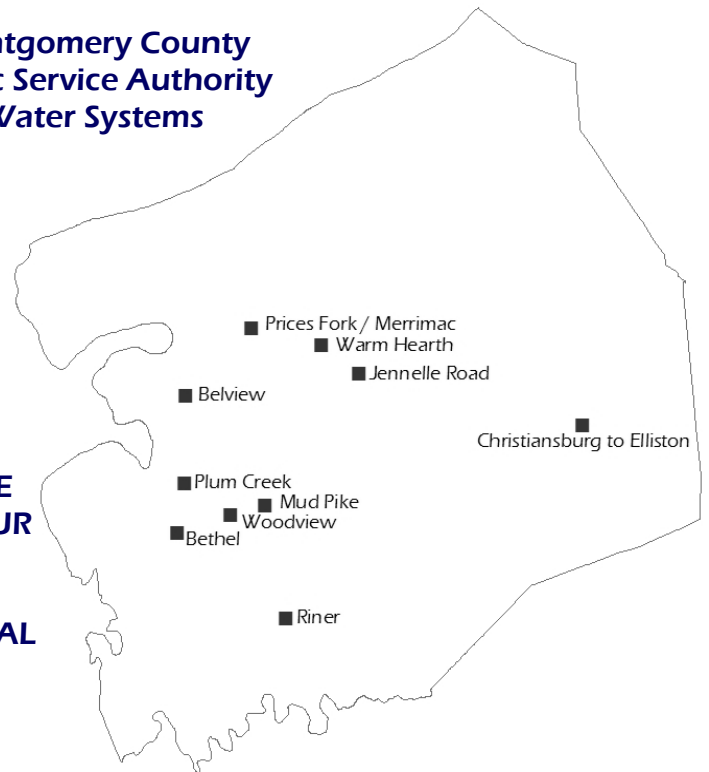

**THE MONTGOMERY COUNTY PUBLIC SERVICE AUTHORITY IS PLEASED TO REPORT THAT YOUR DRINKING WATER IS SAFE AND MEETS OR EXCEEDS ALL VIRGINIA DEPARTMENT OF HEALTH AND UNITED STATES ENVIRONMENTAL PROTECTION AGENCY STANDARDS**

### Introduction

This report is designed to inform you about your drinking water quality. Our goal is to provide a safe and dependable supply of drinking water. We want you to understand the efforts we make to protect your water supply. The quality of your drinking water must meet state and federal requirements administered by the Virginia Department of Health (VDH).

The Montgomery County Public Service Authority (PSA) operates ten individual public water systems in the unincorporated areas of the County. Combined, these systems consist of almost 100

miles of water mains, four wells, 16 water tanks, 22 pumps, 24 pressure reducing valves, seven connections to the NRV Regional Water Authority, two connections to the City of Radford, and one connection to the Arsenal. Approximately 25.5 million gallons of water are distributed by the PSA monthly.

During March of 2014 the connection to the Arsenal was discontinued when the Prices Fork-Merrimac water system was connected to the NRV Regional Water Authority.

If you have questions about this report, please contact:

**Don Todora**  
PSA Operations Specialist  
(540) 381-1997

For additional information about any aspect of your drinking water or to learn how to participate in decisions that may affect the quality of your drinking water, please contact:

**Bob Fronk**  
PSA Director  
(540) 381-1997

PSA board meetings are held at 7:00 p.m. on the first Monday of each month in the County Board Room in the Montgomery County

Government Center, 755 Roanoke Street in Christiansburg.

**Our goal is to provide a safe and dependable supply of drinking water. We want you to understand the efforts we make to protect your water supply.**

**This and other important information are available on the PSA website: [MontVA.com/psa](http://MontVA.com/psa)**

## General information

Drinking water, including bottled drinking water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. **Some people may be more vulnerable to contaminants in drinking water than the general population.** Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. **These people should seek advice about drinking water from their health care providers.** USEPA/CDC guidelines on appropriate means to lessen the risk of infection by cryptosporidium and other microbiological contaminants along with **additional information can be obtained by calling the Environmental Protection Agency's Safe Drinking Water Hotline (800-426-**

**4791) or by visiting their website ([www.epa.gov/safewater](http://www.epa.gov/safewater)).**

**The sources of drinking water** (both tap water and bottled water) **include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.** Contaminants that may be present in source water include:

- (1) Microbial contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- (2) Inorganic contaminants, such as salts and metals, which can be naturally-occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.

(3) Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban storm water runoff, and residential uses.

(4) Organic chemical contaminants, including synthetic and volatile organic chemicals, which are byproducts of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, and septic systems.

(5) Radioactive contaminants, which can be naturally-occurring or be the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, the **USEPA prescribes regulations which limit the amount of certain contaminants in water provided by public water systems.** Food and Drug Administration regulations establish limits for contaminants in bottled water which must provide the same protection for public health.

## Sources and treatment of your drinking water

**The ten water systems operated by the Public Service Authority include both surface water and groundwater sources.** Five are supplied by the NRV Regional Water Authority: Warm Hearth, Belview, Jennelle Road, Christiansburg to Elliston and Mudpike Road. Two are supplied by the City of Radford: Plum Creek and Bethel. Two are supplied by wells operated by the PSA: Riner and Woodview. The remaining system, Price's Fork/Merrimac, was supplied by the Arsenal with a back-up connection to the NRV Regional Water Authority.

In March of 2014 the connection to the NRV Regional Water Authority became the permanent supply to Prices Fork-Merrimac and Prices Fork-Merrimac was connected to Warm Hearth.

**The New River is the surface water source supplying the systems connected to NRV Regional Water Authority, Radford, and the Arsenal.** The raw water goes to either the NRV Regional Water

Authority Treatment Plant, the Radford Water Treatment Plant, or the Arsenal Potable Water Treatment Plant. **Treatment consists of chemical addition, coagulation, flocculation, settling, filtration and disinfection.** All these processes work together to remove the physical, chemical and biological contaminants to make the water safe for drinking. The New River was determined to be of high susceptibility to contamination using criteria developed by the State in its USEPA approved Source Water Assessment Program. **The assessment report consists of maps showing the source water assessment area, an inventory of known land use activities of concern, and documentation of any known contamination within the last five years from the date of the assessment.** Treatment plants are operated to minimize threats associated with potential contamination of these water sources.

**Treatment of the groundwater sources at the PSA's wells consist of the addition of**

**chlorine to disinfect the water.** Chlorine residuals and turbidities are checked on a daily basis at the wells and throughout all the individual distribution systems. Water storage tanks are checked at least three times weekly. **Source water assessments have been completed for the PSA's groundwater supplied systems: Riner and Woodview.** These wells have a high susceptibility to contamination due to migration of contaminants with land use activities of concern, potential conduits to groundwater and/or potential sources of contamination in the assessment areas. **There has been no known contamination of these sources within the last five years.** Source water assessments are available to view upon written request.

## *Quality on Tap*

Contaminants in your drinking water are routinely monitored according to Federal and State regulations. **The table on the following page shows the results of our monitoring for the period of January 1 to December 31, 2014.** Any contaminants not listed in the table were not detected in your drinking water.

**PSA water is routinely monitored for up to 76 regulated, 48 unregulated, and many non-regulated contaminants.** The Virginia Department of Health allows us to monitor for some contaminants less than once per year because the concentrations of these contaminants do not change frequently. Some of our data presented in the following table may be more than one year old.

In the table and elsewhere in this report, you will find many terms and abbreviations with which you might not be familiar. **The following definitions are provided to help you better understand these terms.**

<b>ppm</b> <b>mg/l</b>	<b>parts per million</b> <b>milligrams per liter</b>	One part per million corresponds to one minute in two years, or a single penny in \$10,000.00.
<b>ppb</b> <b>µg/l</b>	<b>parts per billion</b> <b>micrograms per liter</b>	One part per billion corresponds to one minute in 2,000 years, or a single penny in \$10,000,000.00
<b>MCLG</b>	<b>Maximum Contaminant Level Goal</b>	the level of contaminant in drinking water below which there is no known or expected risk to health. MCLG's allow for a margin of safety.
<b>MCL</b>	<b>Maximum Contaminant Level</b>	the highest level of a contaminant that is allowed in drinking water. MCL's are set as close to the MCLG's as feasible using the best available treatment technology.
<b>AL</b>	<b>Action Level</b>	the concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow
<b>pCi/L</b>	<b>Picocuries per liter</b>	a measure of the radioactivity in water
<b>N/A</b>	<b>Not Applicable</b>	abbreviation used in the "range" section
<b>mrem/yr</b>	<b>millirems per year</b>	a measure of radiation absorbed by the body
<b>MRDLG</b>	<b>Maximum Residual Disinfectant Level Goal</b>	the level of drinking water disinfectant below which there is no known or expected risk to health. MRDLG's do not reflect the benefits of the use of disinfectants to control microbial contaminants.
<b>MRDL</b>	<b>Maximum Residual Disinfectant Level</b>	the highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.
<b>TT</b>	<b>Treatment Technique</b>	a required process intended to reduce the level of a contaminant in drinking water
<b>NTU</b>	<b>Nephelometric Turbidity Unit</b>	a measure of the clarity of water. Turbidity in excess of 5 NTU is just noticeable to the average person.
<b>ND</b>	<b>Not Detected</b>	Lab analysis indicates that the contaminant is not present or is below detection limit

## *Additional health information for lead*

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. The Montgomery County Public Service Authority is responsible for providing high quality drinking water but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 15 to 30 seconds or until it becomes cold or reaches a steady temperature before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the **Safe Water Drinking Hotline (800-426-4791)** or at <http://www.epa.gov/safewater/lead>.

## *Drinking water levels*

The U.S. Environmental Protection Agency sets MCL's at very stringent levels. In developing these standards, USEPA assumes that the average adult drinks two liters of water each day throughout a 70-year lifespan. USEPA generally sets MCL's at levels that will result in no adverse health affects for some contaminants or a one-in-one million change of having the described health effect for other contaminants.

# Bethel

## 2014 water quality results of regulated contaminants

### In the distribution system

#### Microbiological contaminants present

CONTAMINANT (units)	MCLG	MCL	LEVEL DETECTED	RANGE	IN COMPLIANCE	DATE OF SAMPLE	TYPICAL SOURCE OF CONTAMINANT
TOTAL ORGANIC CARBON	N/A	TT, met when $\geq 1$	1.00	1.00 to 1.13	YES	2014	Naturally present in the environment
TURBIDITY (NTU)	N/A	TT, 1 NTU max TT, $\leq 0.3$ (95% of the time)	0.166 100%	0.026 to 0.166	YES	2014	Soil runoff

#### Radioactive contaminants present

CONTAMINANT (units)	MCLG	MCL	LEVEL DETECTED	RANGE	IN COMPLIANCE	DATE OF SAMPLE	TYPICAL SOURCE OF CONTAMINATION
COMBINED RADIUM (pCi/L)	0	5	0.1	N/A	YES	2009	Erosion of natural deposits

#### Inorganic contaminants present

CONTAMINANT (units)	MCLG	MCL	LEVEL DETECTED	RANGE	IN COMPLIANCE	DATE OF SAMPLE	TYPICAL SOURCE OF CONTAMINATION
NITRATE/NITRITE (ppm)	10	10	0.44	N/A	YES	2014	Runoff from fertilizer use, leaching from septic tanks, sewage, erosion of natural deposits
BARIUM (ppm)	2	2	0.026	N/A	YES	2014	Discharge of drilling waste, Discharge from metal refineries, Erosion of natural deposits

#### Volatile organic contaminants present

CONTAMINANT (units)	MCLG	MCL	LEVEL DETECTED	RANGE	IN COMPLIANCE	DATE OF SAMPLE	TYPICAL SOURCE OF CONTAMINATION
CHLORINE (ppm)	MRDLG=4	MRDLG=4	1.48	0.5 to 3.3	YES	2014	Water additive used to control microbes
HALOACETIC ACID (ppb)	N/A	60	43	23 to 54	YES	2014	By-product of drinking water disinfection
TOTAL TRIHALO- METHANES (ppb)	N/A	80	34	11 to 48	YES	2014	By-product of drinking water disinfection

### At the customer tap

#### Inorganic contaminants present

CONTAMINANT (units)	MCLG	ACTION LEVEL	90TH PERCENTILE	# SITES EXCEEDING AL	IN COMPLIANCE	DATE OF SAMPLE	TYPICAL SOURCE OF CONTAMINATION
LEAD (ppb)	0	15	1.2	0	YES	2012	Corrosion of household plumbing
COPPER (ppm)	1.3	1.3	0.0172	0	YES	2012	Corrosion of household plumbing

### VIOLATION INFORMATION

There were no violations during 2014.

#### ADDITIONAL INFORMATION ABOUT YOUR WATER

The PSA is continually working to maintain the quality of your water and to improve your water distribution system. Over the past few years many old and undersized water lines have been replaced; most of the PSA's residential water meters have been replaced, and several pressure reducing control valves have also been replaced. In the coming years these improvements will continue.

Other major improvements have been an inspection and maintenance contract to a company for the PSA's water tanks. This company on a scheduled basis washes out, disinfects, paints and repairs both the interior and exterior of the water tanks. Another company has been contracted to inspect, pressure and flow test, and maintain the PSA's fire hydrants. They have also painted and color coded the PSA fire hydrants based on pressure and flows.